



# Simon's Test & Tag Services

A.B.N. 96 224 230 957

In-service safety inspection and testing of electrical equipment  
Compliant with Australian Standard AS/NZS 3760:2010

**\*Sample only of free electronic report\***

Certificate No TTT01802

Ph 0407 800 435

P O Box 2133 East Ivanhoe Vic 3079

## LOG BOOK Page 1

**Customer Name** XYZ Australia (example)

**Contact Person** Peter Smith

**Customer Address** 20 Powell St Hawthorn 3124

**Phone Number** 03-9827-6800

Asset No	Location	Appliance	Make	Model	Description	Test Date	Next Test Due	Pass/Fail	Comments
001	Susan's Office	Extension Lead	Un Branded	5 mtrs	White Colour	25/07/2016	25/07/2017	Pass	0.3 EBR
002	Susan's Office	Power Board	HPM	4 outlets	White Colour	25/07/2016	25/07/2017	Pass	0.2 EBR
003	Susan's Office	Phone Charger	Nokia	AC - 4A	Black Colour	25/07/2016	25/07/2017	Pass	Leakage Test
004	Susan's Office	IEC Power Lead	Sheng	1.8m	Black Colour	25/07/2016	<b>FAIL</b>	<b>FAIL</b>	<b>EARTH BOND OVER LIMIT (1.2)</b>
005	Susan's Office	Dell Monitor	Dell	HA65N55-00	YTR12375374	25/07/2016	25/07/2017	Pass	0.2 EBR
006	Susan's Office	IEC Power Lead	Sheng	2.5m	Black Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
007	Susan's Office	PC	Dell	HLD - 790	JKDZ109445637	25/07/2016	25/07/2017	Pass	0.1 EBR
008	Kate's Office	Desk Fan	Evantair	FT-15B	09357	25/07/2016	25/07/2017	Pass	Insulation & Leakage Tests
009	Kate's Office	HP Charger	HP	381090-001	871266101	25/07/2016	25/07/2017	Pass	Leakage Test
010	Kate's Office	Extension Lead	Arlec	10 Mtrs	White Colour	25/07/2016	25/07/2017	Pass	0.3 EBR
011	Kate's Office	Power Board	HPM - Surge	4 outlets	White Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
012	Kate's Office	Calculator	Canon	P29-D1V	56450052	25/07/2016	25/07/2017	Pass	Insulation Test
013	Kate's Office	IEC Power Lead	VLX	2.5m	Black Colour	25/07/2016	25/07/2017	Pass	0.0 EBR
014	Kate's Office	Monitor	Dell	HA65N55-00	HJHBV1S3457	25/07/2016	25/07/2017	Pass	0.0 EBR
015	Kate's Office	IEC Power Lead	Longwell	1.8m	Black Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
016	Kate's Office	PC	Dell	HLD - 790	JKDZ10944563	25/07/2016	25/07/2017	Pass	0.1 EBR
017	Andrew Office	Extension Lead	Click	5mtrs	White Colour	25/07/2016	<b>FAIL</b>	<b>FAIL</b>	<b>INNER WIRES SHOWING</b>
018	Andrew Office	Power Board	HPM	4 outlets	White Colour	25/07/2016	25/07/2017	Pass	0.3 EBR
019	Andrew Office	IEC Power Lead	Sheng	1.8m	Black Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
020	Andrew Office	Dell Monitor	Dell	E207WFPc	DRET19086345	25/07/2016	25/07/2017	Pass	0.2 EBR
021	Andrew Office	IEC Power Lead	Sheng	2.4mtrs	Black Colour	25/07/2016	25/07/2017	Pass	0.0 EBR
022	Andrew Office	PC	Dell	384021-001	JKDZ10944576	25/07/2016	25/07/2017	Pass	0.2 EBR
023	Andrew Office	Desk Fan	Home Maker	FAN20	White Colour	25/07/2016	25/07/2017	Pass	Insulation & Leakage Tests
024	Daniel's Office	Power Board	HPM	6 outlets	White Colour	25/07/2016	25/07/2017	Pass	0.2 EBR
025	Daniel's Office	Phone Charger	Nokia	PC0235	Black Colour	25/07/2016	25/07/2017	Pass	Leakage Test
026	Daniel's Office	IEC Power Lead	Sheng	1.8m	Black Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
027	Daniel's Office	Monitor	Dell	HA65N55-00	HJHBV1S3429	25/07/2016	25/07/2017	Pass	0.1 EBR
028	Daniel's Office	IEC Power Lead	Longwell	1.6m	Black Colour	25/07/2016	25/07/2017	Pass	0.2 EBR
029	Daniel's Office	Portable Speakers	Logitek	Spk 877	White Colour	25/07/2016	25/07/2017	Pass	Insulation Test
030	Daniel's Office	PC	Dell	LA90PS1-00	YIHG2937625	25/07/2016	25/07/2017	Pass	0.1 EBR



# Simon's Test & Tag Services

A.B.N. 96 224 230 957

In-service safety inspection and testing of electrical equipment  
Compliant with Australian Standard AS/NZS 3760:2010

**\*Sample only of free electronic report\***

Certificate No TTT01802

Ph 0407 800 435

P O Box 2133 East Ivanhoe Vic 3079

## LOG BOOK Page 2

**Customer Name** XYZ Australia (example)

**Contact Person** Peter Smith

**Customer Address** 20 Powell St Hawthorn 3124

**Phone Number** 03-9827-6800


Asset No	Location	Appliance	Make	Model	Description	Test Date	Next Test Due	Pass/Fail	Comments
031	Print Area	IEC Power Lead	Longwell	2.5m	Grey Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
032	Print Area	Multi Function	Fuji Xerox	KM633	55800668	25/07/2016	25/07/2017	Pass	0.1 EBR (250v DC Test)
033	Sam's Office	IEC Power Lead	VLX	1.8m	Black Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
034	Sam's Office	Monitor	Dell	Vostro 220s	YTR6823638	25/07/2016	25/07/2017	Pass	0.1 EBR
035	Sam's Office	IEC Power Lead	VLX	1.8m	Black Colour	25/07/2016	25/07/2017	Pass	0.3 EBR
036	Sam's Office	PC	Dell	384021-001	5YC425	25/07/2016	25/07/2017	Pass	0.3 EBR
037	Sam's Office	Phone Charger	Force	EC5	Black Colour	25/07/2016	25/07/2017	Pass	For Mobile
038	Reception	Oil Heater	Heller	OHH719	Grey Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
039	Reception	Clock Radio	BASE	CR3100	909871279	25/07/2016	25/07/2017	Pass	Insulation Test
040	Reception	IEC Power Lead	Sheng	2.5m	Black Colour	25/07/2016	25/07/2017	Pass	0.0 EBR
041	Reception	Monitor	Dell	Vostro 220s	2YC98422S	25/07/2016	25/07/2017	Pass	0.1 EBR
042	Reception	IEC Power Lead	VLX	1.8m	Black Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
043	Reception	PC	Dell	X223W	ETLAVO3514E4d4	25/07/2016	25/07/2017	Pass	0.1 EBR
044	Kitchen	Toaster - 2 Slice	Breville	BT320	White Colour	25/07/2016	25/07/2017	Pass	0.2 EBR
045	Kitchen	Coffee Machine	Sunbeam	EM3600	Black Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
046	Kitchen	Fridge	LG	GR-242MF	NR63LAEG	25/07/2016	25/07/2017	Pass	0.1 EBR
047	Kitchen	Kettle	Kambrook	K0250	White Colour	25/07/2016	<b>FAIL</b>	<b>FAIL</b>	<b>DOES NOT TURN OFF</b>
048	Kitchen	Microwave	Panasonic	NN-S235WF	5EO5260386	25/07/2016	25/07/2017	Pass	0.1 EBR
049	Kitchen	Sandwich Toaster	Breville	SG620	724	25/07/2016	<b>FAIL</b>	<b>FAIL</b>	<b>BURNT LEAD</b>
050	Dean's Office	IEC Power Lead	Longwell	2.5m	Black Colour	25/07/2016	25/07/2017	Pass	0.1 EBR
051	Dean's Office	Monitor	Samsung	712n	JYBDS87900054	25/07/2016	25/07/2017	Pass	0.1 EBR
052	Dean's Office	Power Lead	VLX	1.5m	Black Colour	25/07/2016	25/07/2017	Pass	0.2 EBR
053	Dean's Office	A/C Adaptor	Dell	CHR 6548	HGKU1786583	25/07/2016	25/07/2017	Pass	For Laptop
054	Peter's Office	IEC Power Lead	Sheng	2m	White Colour	25/07/2016	25/07/2017	Pass	0.2 EBR
055	Peter's Office	Monitor	Samsung	913R	GFDJ7642037	25/07/2016	25/07/2017	Pass	0.2 EBR
056	Peter's Office	Power Board	Ring Grip	4 outlets	White Colour	25/07/2016	<b>FAIL</b>	<b>FAIL</b>	<b>LOOSE INSIDES</b>

**EBR = Earth Bond Resistance (1.0 Ohm is the safety limit per standards AS/NZS 3760:2010)**

**All appliances were visually inspected first for damage and if they passed, were then tested on the PAT Tester to Standards AS/NZS 3760:2010**



\* Tag 004 - PC IEC Lead FAILED Earth Bond Test

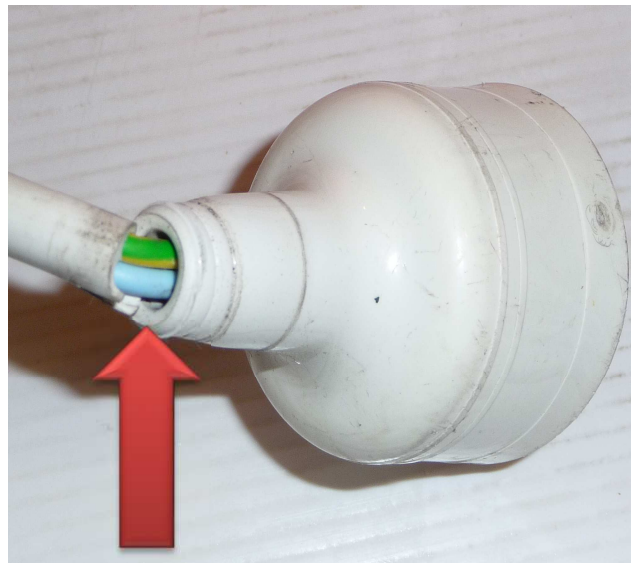


\* Tag 017 - FAILED extension lead - wires showing




\* Tag 047 Kettle FAILED - Does not switch off



\* Tag 049 FAILED - has a damaged lead

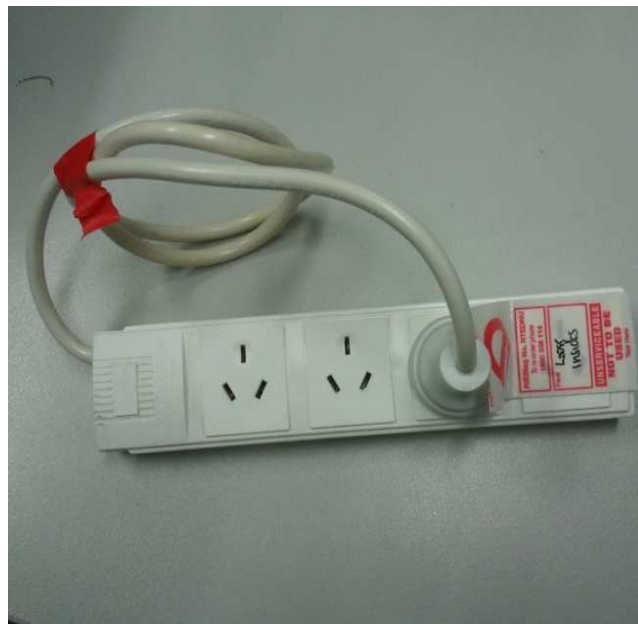

\* Tag 056 FAILED - has loose insides

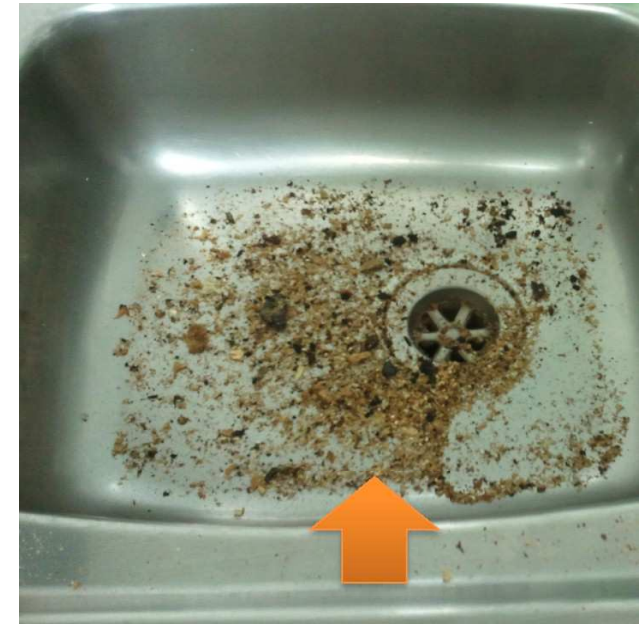

\* Bread Crumbs from Toaster - needs regular emptying!